HTHB-HAC-RF

Model HTHB-HAC-RF Filtered HAC Retro Fit Hydroboost® Bottle Filler

for HAC models

*Rated for Indoor Use Only







Filtered Bottle Filler Retro-Fit

Bottle filling station designed to retro-fit existing HAC pushbar

HYDROBOOST® RETRO-FIT BOTTLE FILLING STATION

activated models. Applicable on 115V models only. Rated for indoor use. Supplied with basin to ensure proper fit and allow for easy installation. Ideal for use in sports and fitness centers, educational and healthcare facilities, airports, office buildings and many other

Sensor-activated enhanced with user interface graphics. Quick fill rate is 1.5 gallons per minute on refrigerated model or 1.1 gallons per minute on non-refrigerated model. Laminar flow provides a clean fill to minimize splashing and easy maintenance. Equipped with an automatic 20-second shut-off timer.

SILVER ION ANTI-MICROBIAL PROTECTION

Key plastic components are integrated with silver ion anti-microbial protection to inhibit growth of mold and mildew.

GREEN COUNTER™

MODEL:

GENERAL

commercial buildings.

Visually displays count of plastic bottles saved from landfills. (Based on 20 oz. bottles for refrigerated models)

LEAD REDUCTION FILTER WITH FILTER LIFE INDICATOR

Equipped with the HWF3000 WaterSentry® Plus Filter. Quick-Disconnect, 1/4 turn installation and automatic inlet shut-off valve that closes when filter is removed. High-grade filter is made with activated carbon and patented ATS lead-removal media. Certified to NSF/ANSI 42 for Chlorine-Class 1. Particulate-Class 1 and Taste and Odor and NSF/ANSI 53 for Lead Reduction, Filter is rated for a 3,000 gallon capacity.

Green, yellow and red LEDs visually indicate when filter maintenance is required.

Replacement Filters: Available as Singles and Multi-Packs. Order part numbers:

- 55898C (single)
- 55898C_3PK (three pack)
- 55898C_12PK (twelve pack)
- 55898C 24PK (twenty-four pack)
- 55898C_48PK (forty-eight pack)

SUGGESTED SPECIFICATION

Unit shall include a bottle filling station that retrofits onto a cooler. Model HTHB-HAC-RF shall retro-fit existing 115V pushbar activated HAC models. Shall include basin to ensure proper fit and function. Bottle filler shall include electronic sensor for no-touch activation with automatic 20-second shut-off timer. Shall include a Green Counter™ displaying the count of plastic bottles saved from the landfill. Shall include the WaterSentry® Plus 3000-gallon capacity filter, certified to NSF/ANSI 42 for Chlorine-Class 1, Particulate-Class 1 and Taste and Odor and NSF/ANSI 53 for lead reduction, with LED visual filter monitor indicate when filter maintenance is required. include anti-microbial protected components to prevent mold and mildew. Shall comply with ADA guidelines for visual and motion The manufacturer shall certify the unit to meet the disabilities. requirements of NSF/ANSI 61 and 372, UL CAN/CSA 22.2 No. 120.

CAPACITIES CHART

| Model No. | GPH Capacity Cooled to 50°F** | | | | Base Rate Cap. | F.L. Amps | Shipping Weight Ib. | Rated Watt Usage |
|--------------|-------------------------------|------|-------|-------|----------------------|--------------|---------------------------|------------------------|
| | Ambient Air Temp | | | | | | | |
| | 70°F | 80°F | 90°Ft | 100°F | oup. | | | Jougo |
| HTHB-HAC-RF | - | - | - | - | - | 1.0 | 32 | 120 |

NOTE: Continued product improvement makes specification sheets subject to change without notice.

Protected by Halsey Taylor's Limited Warranty. Warranty details available at halseytaylor.com.









^{*} With projector service and tap water at 80°F

^t UL 399 and ASHRAE (previously ARI 1010) compliant

Model HTHB-HAC-RF Filtered HAC Retro Fit HydroboosT® Bottle Filler

OPERATING PRESSURES

Supply water - 105 psi maximum Minimum 40 psi supply line pressure required in special circumstances where both sides of bi-level are in use simultaneously to ensure adequate stream height. Use of water filter in this situation is not recommended. NOTE: A service stop (not included) must be installed at the water inlet line.


NOTE: P-Trap (not supplied) to be installed per local building code.

ELECTRICAL

Hydroboost® station equipped with electric cord and three-prong molded rubber plug for use with 15-amp minimum receptacle. Rated at 115 volt, 60 Hz, single phase.

SINGLE COOLER

FRONT VIEW SIDE VIEW

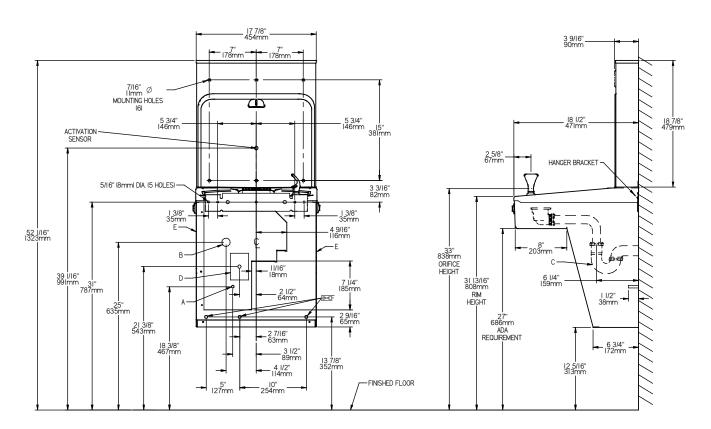

REDUCE HEIGHT BY 3" FOR INSTALLATION OF CHILDRENS ADA COOLER

LEGEND:

- A = Recommended Water Supply location. Shut-off Valve (not furnished) to accept 3/8" O.D. unplated copper tube. Up to 3" (76mm) maximum out from wall.
- B = Recommended Waste Outlet location. To accommodate 1-1/4" nominal drain. Drain stub 2" (51mm) out from wall.
- C = 1-1/4" Trap (not furnished).
- D = Electrical Supply (3) Wire Recessed Box Duplex Outlet.
- E = Insure proper ventilation by maintaining 6" (152mm) minimum clearance from cabinet louvers to wall.
- F = 7/16" (11mm) Bolt Holes for fastening to wall.
- **New Installations Must Use Ground Fault Circuit Interrupter (GFCI).

| Halsey | Taylor |
|--------|--------|
|--------|--------|

| Job Name: | |
|---------------------|-----|
| Model: | Qty |
| Contact: | |
| Approval Signature: | |
| Notes: | |
| | |
| | |

Page 2 Printed in the U.S.A.

Model HTHB-HAC-RF Filtered HAC Retro Fit Hydroboost® Bottle Filler

OPERATING PRESSURES

Supply water - 105 psi maximum Minimum 40 psi supply line pressure required in special circumstances where both sides of bi-level are in use simultaneously to ensure adequate stream height. Use of water filter in this situation is not recommended. NOTE: A service stop (not included) must be installed at the water inlet line.


NOTE: P-Trap (not supplied) to be installed per local building code.

ELECTRICAL

Hydroboost® station equipped with electric cord and three-prong molded rubber plug for use with 15-amp minimum receptacle. Rated at 115 volt, 60 Hz, single phase.

BI-LEVEL COOLER

FRONT VIEW SIDE VIEW

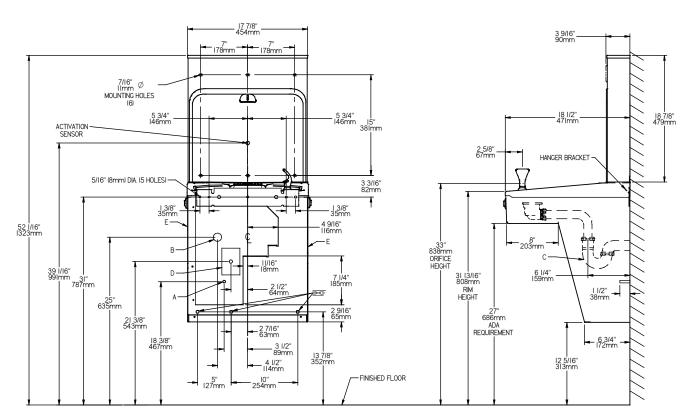

REDUCE HEIGHT BY 3" FOR INSTALLATION OF CHILDRENS ADA COOLER

LEGEND:

- A = Recommended Water Supply location. Shut-off Valve (not furnished) to accept 3/8" O.D. unplated copper tube. Up to 3" (76mm) maximum out from wall.
- B = Recommended Waste Outlet location. To accommodate 1-1/2" nominal drain. Drain stub 2" (51mm) out from wall.
- C = 1-1/2" Trap (not furnished).
- D = Electrical Supply (3) Wire Recessed Box Duplex Outlet.
- E = Insure proper ventilation by maintaining 6" (152mm) minimum clearance from cabinet louvers to wall.
- F = 7/16" (11mm) Bolt Holes for fastening to wall.
- **New Installations Must Use Ground Fault Circuit Interrupter (GFCI).

| Halsey | Taylor |
|--------|--------|
|--------|--------|

| Job Name: | |
|---------------------|-------|
| Model: | _ Qty |
| Contact: | |
| Approval Signature: | |
| Notes: | |
| | |
| | |

Page 3 Printed in the U.S.A.